




**PORT O' CONNOR IMPROVEMENT DISTRICT
39 DENMAN DR
(361) 983-2652**

SEWER HOOKUP INSTRUCTIONS

1. A "SEWER CHECK VALVE" PREVENTION DEVICE MUST BE INSTALLED.
2. 4" SCHEDULE 40 PVC PIPE OR SDR 26 PIPE IS REQUIRED. ALL PIPING MUST BE GLUED.
3. GRAVITY LINE FROM HOUSE TO PIT LEG MUST HAVE A MINIMUM 2% SLOPE.
4. RUN PIPE TO CLOSEST PROXIMITY OF PIT UP TO UTILITY EASEMENT.
5. LEG ON PIT IS APPROXIMATELY 54" DEEP.
6. ONCE PIPE IS RUN-CALL DISTRICT AT (361) 983-2652 FOR INSPECTION BEFORE COVERING PIPE UP. FINAL HOOK-UP BY PLUMBER AT TIME OF FINAL INSPECTION

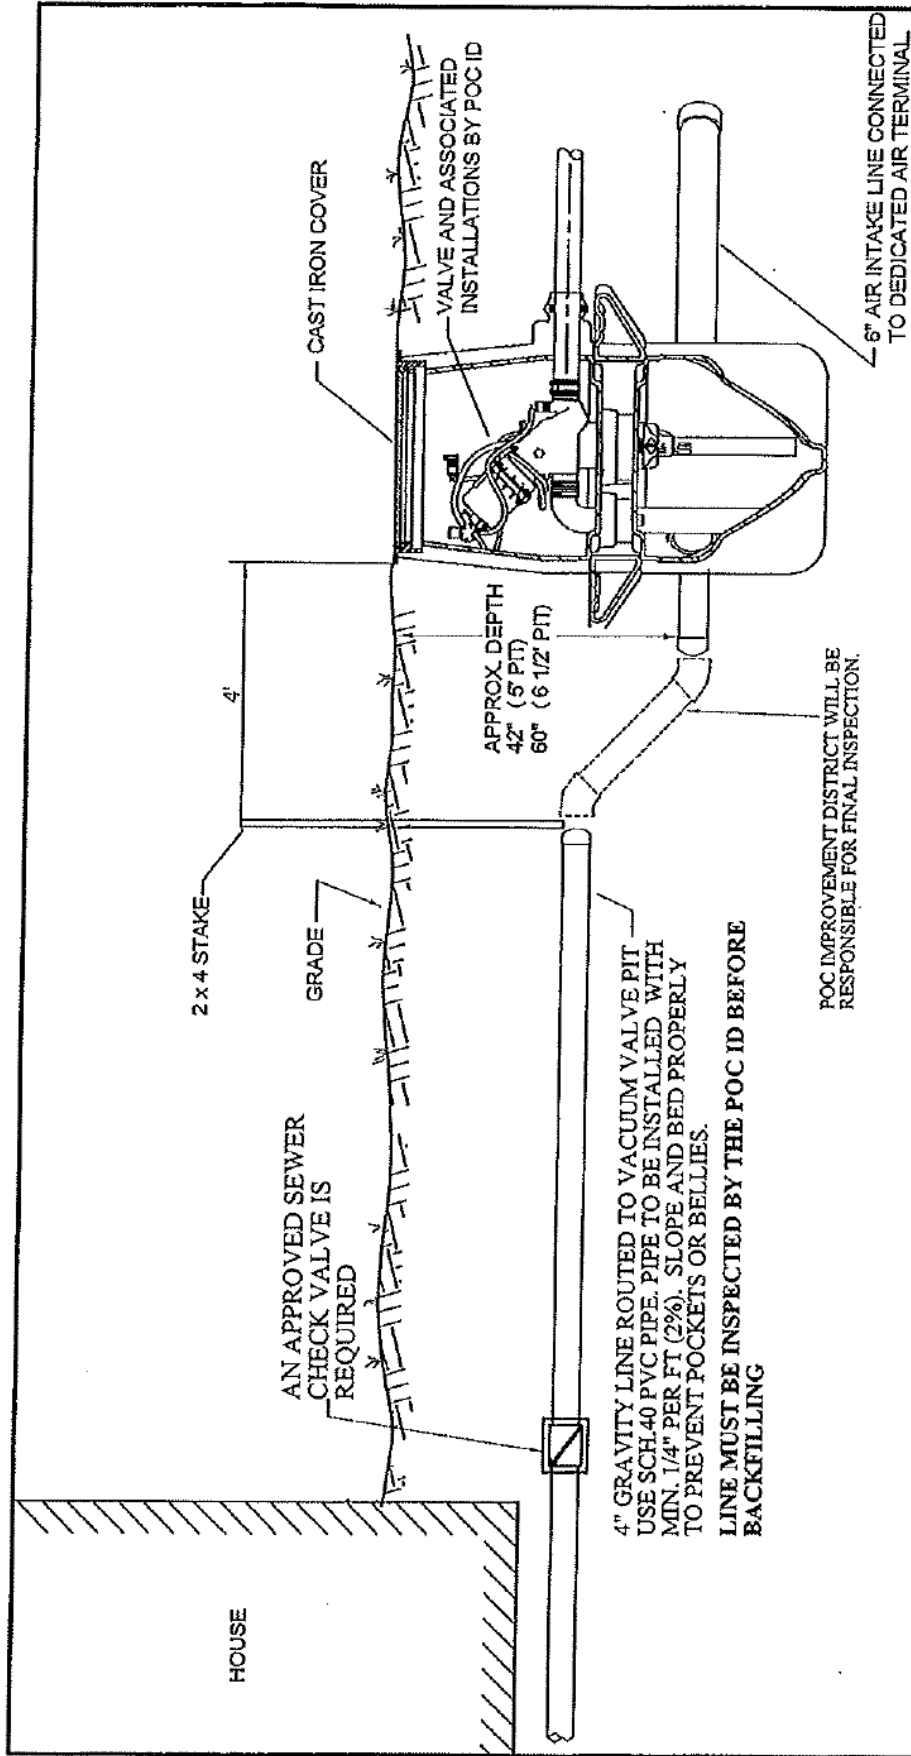

VALVE PIT AFTER HOME HOOK-UP -- SD - 19 6" AIR-INTAKE AT THE VALVE PIT



PORT O'CONNOR IMPROVEMENT DISTRICT

39 Denman Drive · Port O'Connor, Texas · 77982
 PH: 361-983-2652 · FAX: 361-983-2235

DRAWN BY: DJG
JOB NO.: 1580.000
SCALE: NONE
DATE: 4-24-14
AMENDED: 12-13-19